




Stewards of the Environment™

2020 Water Quality Report

Millbury System

Water: It's Too Precious
To Waste.

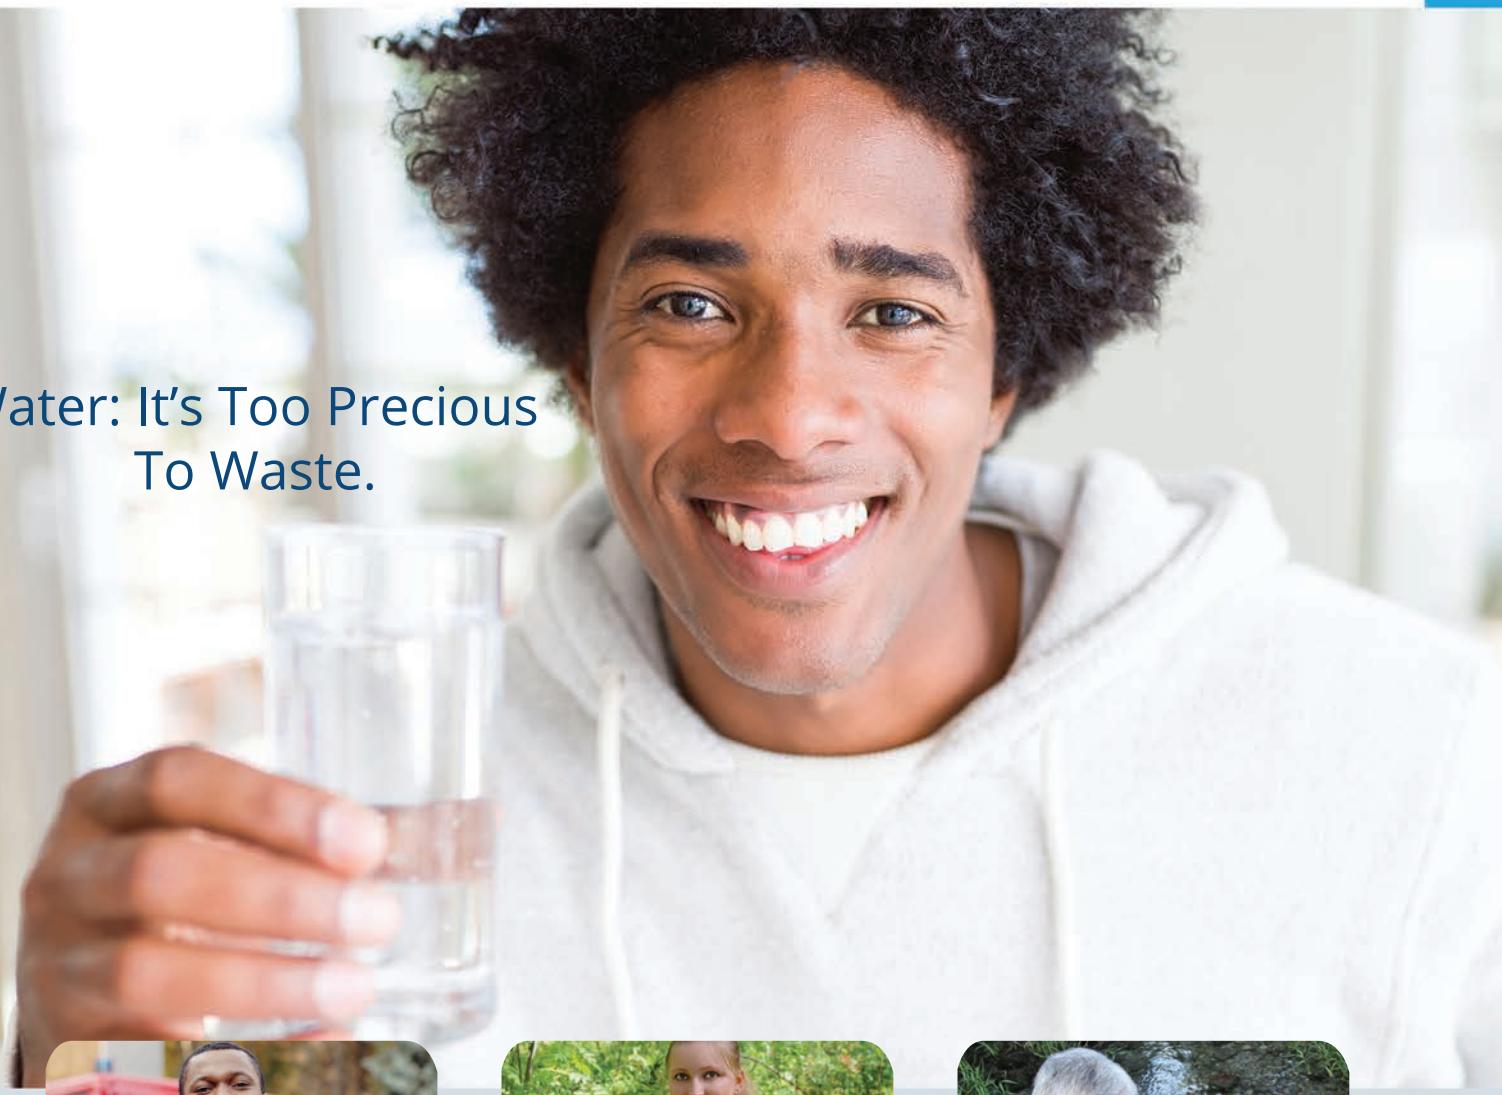

A Message from the Vice President



John Walsh
Vice President,
Operations
Aquarion Water
Company of MA

Dear Aquarion Customer:

Despite the many challenges the pandemic has brought, we at Aquarion are grateful that we were able to continue providing you and all our customers with reliable, high-quality water delivery and services throughout the past year.

We never let up on our rigorous, quality-control measures. During 2020, we conducted more than 6,000 tests of the water in our Massachusetts systems. Once again, all results met or exceeded state and federal water quality standards. We were particularly thankful when federal authorities reported that the COVID-19 virus hasn't been detected in drinking water supplies anywhere — and should it ever appear, highly effective treatment methods such as ours would eliminate any risk.

This report contains details about our voluntary testing program for per- and polyfluoroalkyl substances (PFAS) in our water supplies. These man-made chemicals have been manufactured and used since the 1950s, but there is growing concern across the nation about the PFAS that could be in public drinking water. Results from our proactive testing program in 2019 identified that one of our wells (the Oak Pond Well) had PFAS levels above state and federal health advisory recommendation. As a result, we immediately shut the well off and began coordinating with the Massachusetts' Department of Environmental Protection (MassDEP). In 2020, we proceeded with the planning and design of a treatment facility to remove PFAS from this well's water, and we expect to complete that facility within the next couple of years. Until that time, the Oak Pond well will remain off. For more detailed information about PFAS and our sampling results, you can visit our website: www.aquarionwater.com/pfas.

Aquarion is committed to continuing its investment in Millbury's water infrastructure. In addition to the treatment facility for our Oak Pond well described above, we completed the installation of new water mains to replace existing, older mains on Elm Street, Elmwood Street, Main Street, Millbury Center, and South Main Street.

As in past years, we've enjoyed taking part in and sponsoring community events and organizations. Aquarion is a proud to support Millbury Little League and Girls Softball, the Millbury Police Association, the Millbury Fire Department, VFW Post 3329, the Olive Branch Lodge, Millbury schools and many other community organizations.

Drought was another challenge in 2020. A year of drought strained water supplies throughout the state, especially as more people worked from home. Our mandatory irrigation schedule again was highly successful in safeguarding supplies.

I'll close with sincere thanks to all our customers for everything you do to conserve water. For more ways to save this precious resource, please look elsewhere in this report and at www.aquarionwater.com/conserve.

With Appreciation,

John Walsh

Millbury System Water Quality Table

Your water has been tested for more than 100 compounds that are important to public health. Only 15 of these were detected, all of which were below the amounts allowed by state and federal law. Most of these

compounds are either naturally occurring or introduced as treatment to improve water quality. Monitoring frequency varies from daily to once every nine years per EPA regulation, depending on the parameter.

Our testing encompasses the full range of regulated inorganic, organic and radiological compounds and microbiological and physical parameters. Results shown below are for detected compounds only.

Substance (Units of Measure)	Highest Allowed by Law			Test Date	Millbury System Detected Level	
	MCLG	MCL	Compliance		Average	Range
Inorganic Compounds						
Barium (ppm)	2	2	YES	2018, 2019	0.078	0.060 – 0.095
Copper (ppm)	1.3	AL = 1.3	YES^	2020	0.47*	
Fluoride (ppm)	4.0	4.0	YES	2018, 2020	0.22	ND < 0.10 – 0.65
Lead (ppb)	0	AL = 15	YES^	2020	ND < 1**	
Nitrate (ppm)	10	10	YES	2020	1.304	0.230 – 2.490
Perchlorate (ppb)	NA	2	YES	2020	ND < 0.02	ND < 0.02 – 0.10
Microbials						
Turbidity (NTU)	NA	TT = 1 max	YES	2020	0.05 ⁺	0.03 – 0.07
Turbidity (NTU)	NA	TT = 95% of samples < 0.3	YES	2020	100%	
Disinfectant						
Chlorine (ppm)	MRDLG 4	MRDL 4	YES	2020	0.84	0.50 – 1.21
Organic Compounds						
Total Trihalomethanes (ppb)	NA	80	YES	2020	27***	17 – 42
Total Haloacetic Acids (ppb)	NA	60	YES	2020	14***	4 – 22
2,4-D (ppb)**	70	70	YES	2020	ND < 0.1	ND < 0.1 – 0.14
Radiologicals						
Radium 226 & 228 (pCi/L)	0	5	YES	2015	ND < 0.8	ND < 0.8 – 1.4
Inorganic Compounds						
Chloride (ppm)	NA	SMCL = 250	NA	2020	192	95 – 357
Manganese (ppb)	HA = 300	SMCL = 50	NA	2020	5.0	ND < 2 – 10
Sodium (ppm)	NA	ORSG = 20	NA	2020	178	50 – 219

(See footnotes and definitions on page 4)

Footnotes and Definitions

for water quality table on previous page

<	Less than	***	Reported value is the highest locational, annual average of quarterly measurements for disinfection by-products in the distribution system. Values in the range are individual measurements.
AL	Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.	+	Value is the highest monthly average for turbidity reported from the Millbury Avenue treatment plant effluent. Values in the range are individual measurements. Turbidity is a measure of the cloudiness of the water. We monitor it because it is a good indicator of water quality.
HA	Health Advisory	++	Only detected in one sample from the Millbury Avenue well.
MCL	Maximum Contaminant Level: The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.	^	In 2020, Aquarion Water received a monitoring violation for lead and copper. All sample results were in compliance. See page 11 for details of the violation.
MCLG	Maximum Contaminant Level Goal: The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.		
MRDL	Maximum Residual Disinfectant Level: The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.		
MRDLG	Maximum Residual Disinfectant Level Goal: The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contamination.		
NA	Not Applicable		
ND	Not detected		
NTU	Nephelometric Turbidity Units, a measure of the presence of particles. Low turbidity is an indicator of high-quality water.		
ORSG	Office of Research and Standards Guideline – State of Massachusetts		
pCi/L	Picocuries per liter		
ppb	parts per billion, or micrograms per liter (ug/L)		
ppm	parts per million, or milligrams per liter (mg/L)		
SMCL	Secondary Maximum Contaminant Level		
TT	Treatment Technique: A required process intended to reduce the level of a contaminant in drinking water.		
*	90th percentile value in copper monitoring. Result is representative of customers sampling stagnant water. No locations exceeded the action level for copper.		
**	90th percentile value in lead monitoring. Result is representative of customer sampling stagnant water. No locations exceeded the action level for lead.		

HEALTH EFFECTS

Manganese: Manganese is a naturally occurring mineral found in rocks, soil, ground water, and surface water. It is necessary for proper nutrition and is part of a healthy diet, but it can have undesirable effects on certain sensitive populations at elevated concentrations. The United States EPA and MassDEP have set an aesthetics-based Secondary Maximum Contaminant Level (SMCL) for manganese of 50 ppb (parts per billion or micrograms per liter). In addition, MassDEP's Office of Research and Standards (ORS) has set a drinking water guideline for manganese (ORSG), which closely follows the EPA public health advisory for this mineral. Drinking water may naturally have manganese and, when concentrations are greater than 50 ppb the water may be discolored and taste bad. Over a lifetime, the EPA recommends that people drink water with manganese levels less than 300 ppb and over the short term, it recommends that people limit their consumption of water with levels over 1,000 ppb, primarily due to concerns about possible neurological effects. Children up to 1 year of age should not be given water with manganese concentrations over 300 ppb, nor should formula for infants be made with that water for more than a total of 10 days throughout the year.

Sodium: Sodium-sensitive individuals such as those experiencing hypertension, kidney failure, or congestive heart failure, who drink water containing sodium should be aware of levels where exposures are being carefully controlled.

Understanding Your Water Quality Table

Barium:	Erosion of natural deposits.
Copper:	Corrosion of household plumbing systems.
Fluoride:	Water additive that promotes strong teeth; erosion of natural deposits.
Lead:	Corrosion of household plumbing systems.
Nitrate:	Runoff from fertilizer use; leaching from septic tanks, sewage; erosion of natural deposits.
Perchlorate:	Fireworks, munitions, flares, blasting agents. Breakdown product of disinfection additive.
Turbidity:	Sediment particles; naturally occurring iron and manganese; soil runoff.
Chlorine:	Water additive used to control microbes.

Total Trihalomethanes:

By-product of drinking water chlorination.

Total Haloacetic Acids:

By-product of drinking water chlorination.

2,4-D:

Runoff from herbicide used on row crops.

Radium 226 & 228:

Erosion of natural deposits.

Chloride:

Naturally present in the environment.

Manganese:

Erosion of natural deposits.

Sodium:

Water treatment processes; use of road salt;

naturally present in the environment.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants

does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained

by calling the EPA's Safe Drinking Water Hotline ([800-426-4791](tel:800-426-4791)). Here is some additional information of interest about Aquarion's drinking water.

Where does your water come from?

The water provided to our Millbury customers comes from three groundwater supply wells. The Oak Pond well was not in service in 2020. The water from each well is treated and then distributed to our customers through an extensive network of over 52 miles of piping and a 1.2-million-gallon water storage tank. Our water supply system is located within the Blackstone River Watershed and serves approximately 8,800 people. The average amount of water from our sources delivered to the Millbury system in 2020 was 1.61 million gallons per day.

The City of Worcester supplemented our own sources by providing 57.4 million gallons of water to our system in 2020, accounting for 9.7% of the total use. The distribution system is also interconnected to the water system in Grafton for emergencies or periods of high water use.

How is your water treated?

All water from the four wells is filtered naturally underground and then receives chemical treatment for disinfection and pH adjustment. The water from the Millbury Avenue well receives additional treatment including filtration at the Millbury Avenue Water Treatment Facility. Water from the two Jacques wells receives supplemental treatment using ion exchange to remove perchlorate from the water.

Cryptosporidium

The EPA requires public water systems that use surface water sources to monitor for Cryptosporidium. This is a microbial pathogen found in lakes and rivers throughout the U.S. that can cause gastrointestinal illness if consumed. Aquarion continues to monitor its surface water sources and has not detected Cryptosporidium.

Source Water Assessment Report

The Massachusetts DEP's Source Water Assessment Program (SWAP), which has evaluated each water source to identify potential contamination, states that the water sources that supply drinking water to the Millbury System have a high susceptibility to potential contamination. The report is available on the DEP website at mass.gov/dep/water/drinking/2186000.pdf.

(continued on page 6)

Monitoring Unregulated Contaminants

Unregulated contaminants are elements that currently have no health standards for drinking water and are not reported in the regulated contaminants table on page 3. Nickel is an

unregulated contaminant that is monitored at the same time as the required monitoring for inorganic compounds.

Substance (Units of Measure)	Test Date	Detected Level		Source of Contaminant
		Average	Range	
Nickel (ppm)	2018, 2020	0.002	ND < 0.001 - 0.003	Erosion of natural deposits.
ppm Parts per million			ND Not detected	

Copper

Copper is an essential nutrient, but some people who drink water containing copper in excess of the action level* over a relatively short period of time could experience gastrointestinal distress. Some people who drink water containing copper in excess of the action level over many years could suffer liver or kidney damage. People with Wilson's Disease should consult their doctor. Major sources of copper in drinking water include corrosion of household plumbing systems and erosion of natural deposits.

*The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Disinfection by-products

Disinfection by-products (DBPs) are chemicals formed during the disinfection process, when naturally occurring organic matter reacts with chlorine, which is added to water to eliminate bacteria and other microorganisms. Currently there are limits on two types of DBPs known as Total Trihalomethanes (TTHM) and Total Haloacetic Acids (THAA). Some people who drink water containing DBPs that exceed these limits over many years may experience problems with

their livers, kidneys, or central nervous systems, and may have an increased risk of getting cancer.

The state has implemented new DBP regulations that change how compliance with the standards is determined. The intent is to increase protection against the potential health risks associated with DBPs. Aquarion Water Company continues to evaluate its systems to ensure compliance with DBP regulations.

Immuno-compromised people

Some people may be more vulnerable to contaminants in drinking water than the general population. Immuno-compromised people such as those with cancer undergoing chemotherapy, people who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice about drinking water from their health-care providers. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline ([800-426-4791](tel:800-426-4791)).

Lead in Drinking Water: The Facts

The federal Environmental Protection Agency (EPA) and Massachusetts Department of Public Health have established extensive regulations for water utilities to follow with regard to lead — and for very good reason. If present in drinking water, lead can cause numerous harmful effects on a person's health. The EPA has determined there is no safe level of lead.

Aquarion monitors for lead in the water we provide, by testing stagnant tap water samples from high-risk homes (such as homes built before 1950). We follow regulations mandated by the Safe Drinking Water Act, in which the EPA established a limit: 15 parts per billion (or micrograms per liter) in no more than 10 percent

of tap water samples. Meeting this limit indicates that the water is minimally corrosive to lead.

If tests reveal that more than 10 percent of tested homes exceed the limit, then the EPA mandates a series of actions we would have to take. These include water treatment, notifying customers about the issue and removing lead service lines. The Aquarion system that supplies your water complies with the lead limit. Even so, some homes may have elevated lead levels due to lead materials in the plumbing or service line.



(continued on page 7)

Lead in Drinking Water: The Facts

(continued from page 6)

Health effects

Lead is especially harmful for infants and young children, causing developmental delays, learning difficulties, irritability, loss of appetite, weight loss, sluggishness, fatigue, abdominal pain, vomiting, constipation and hearing loss.

Effects on adults may include high blood pressure, abdominal pain, constipation, joint pains, muscle pain, decline in mental functions such as abstract thinking and focus, numb or painful extremities, headache, memory loss, mood disorders, fertility issues in men, and miscarriage or premature birth in pregnant women.

What to do about a lead service line

A service line is the pipe that connects a customer's premises to Aquarion's water main in the street. The customer owns the portion of the service line closest to the premises, while Aquarion owns the portion closest to the street. In some older structures built before 1950, these lines may have been made of lead.

If present, a lead service line can be the primary source of lead in your drinking water, because there is a much greater surface area where lead contacts the water, compared to lead-soldered pipe joints and leaded brass fixtures.

Therefore, if your house was built prior to 1950, you should check the service line where it enters the wall of your basement to see if it is made of lead. If it is a lead line, contact Aquarion at [800-732-9678](tel:800-732-9678) for advice on replacing it. This will help reduce your potential exposure to lead in drinking water.

Other precautions you can take

Health issues from lead exposure cannot be cured, but they can be prevented, especially in drinking water. The best methods for reducing your exposure to lead include removing lead service lines and lead in your home's plumbing, and reducing the amount of time your water sits

stagnant in contact with lead materials in the service lines and faucets.

- If you have not used any of your faucets for a number of hours (for example, overnight or while you are at work), run the water for several minutes. This will bring in fresh water from our water main, which contains no lead. (To conserve water, catch the flushed tap water in buckets or pots to use for cleaning or to water plants.)
- Always use cold water for drinking, cooking and preparing baby formula. Never cook with or drink water from the hot water tap. Never use water from the hot water tap to make baby formula.
- Periodically remove and clean the faucet screens/aerators. While doing so, run the tap to eliminate debris.
- Check your service line where it enters your building and determine if it is made of lead. If it is, replace it.
- Identify and replace old plumbing fixtures that contain lead. Brass faucets, fittings and valves may leach lead into drinking water — especially those purchased before 2014.



Homeowners who want to determine whether there is lead in their water should have a laboratory test it. There is a list of certified testing laboratories on the state Department of Public Health's website (www.ct.gov/dph).

For more information, our website has a section dedicated entirely to lead in drinking water; visit www.aquarionwater.com/learningaboutlead. If you have questions, call our Water Quality Department at [800-832-2373](tel:800-832-2373). You also can email us at waterquality@aquarionwater.com.

(continued on page 8)

The EPA advises:

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water comes primarily from materials and components associated with service lines and home plumbing. Aquarion Water Company is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. Fortunately, the Lead in Drinking Water Act, which took effect in January 2014, requires a significant reduction of the lead content in new plumbing components that contact drinking water. As a result, the lead content in new pipes, fittings, fixtures and solder must be reduced from 8% to 0.25%.

Customers can minimize the potential for lead exposure when water has been sitting for several

hours by running the tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline or at www.epa.gov/safewater/lead.



Water Protection: Information You Should Know

Protecting water at the source

Even small quantities of pollutants may be enough to contaminate a drinking water supply. Examples of pollutants that may wash into surface water or seep into ground water include:

- Microbial contaminants from septic systems, agriculture and livestock operations, and wildlife;
- Inorganic contaminants such as salts and metals that can be naturally occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, or farming;
- Pesticides and herbicides from sources such as agriculture, urban storm water runoff, and residential uses;
- Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes; and
- Radioactive contaminants that can be naturally occurring.

Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. In order to ensure tap water is safe to drink, EPA and MassDEP prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline (800-426-4791).



(continued on page 9)

How Aquarion protects your drinking water

Aquarion Water Company's commitment to providing the highest quality water is evidenced by our regular inspection of homes, businesses, farms and other sites that could pollute water supplies. We also review new land development projects for impact on water quality. In total, we conduct more than 6,000 water quality tests annually. We use the best water treatment and filtration technology and continue to invest in our water systems' infrastructure to improve your water security and quality.

You can help prevent water contamination

- Ensure that your septic system is working correctly.
- Use chemicals and pesticides wisely.
- Dispose of waste chemicals and used motor oil properly.
- Report illegal dumping, chemical spills, or other polluting activities to the MA DEP's Emergency Response Section at (888-304-1133), Aquarion Water (508-865-3998), or your local police.



Protecting your water at home:

Cross-Connection Control Program

Our Cross-Connection Control Program helps ensure that your drinking water is protected from possible contamination. A cross-connection, as defined by the Massachusetts Department of Environmental Protection (DEP), "is any actual or potential connection between a distribution pipe of potable water from a public water system and any waste pipe, sewer, drain, or other unapproved source that has the potential, through

backpressure or back-siphonage, to create a health hazard to the public water supply and the water system within the premises."

Aquarion's DEP-certified cross-connection surveyors and testers routinely conduct surveys and test backflow prevention devices at our customers' facilities for regulatory compliance. If they find unprotected cross-connections, they will require installation of a backflow prevention system.

The best protection against cross-connection contamination is to eliminate the link. Garden hoses are a leading cause of cross-connection contamination. At your home, you can protect your family and the distribution system from potential contaminants by installing a simple, inexpensive backflow device called a Hose-Bibb Vacuum Breaker (HBVB) that mounts directly to your spigot.

Water conservation in your home

Our water supply is sufficient to meet your needs, but we still encourage you to conserve this precious natural resource for the good of our environment.

There are plenty of simple steps you can take to reduce your water consumption: fix faucet and toilet leaks; turn off the water while shaving or brushing your teeth; run full loads in your dishwasher and clothes washer; water your lawn in early morning; and use a broom to clean debris from your driveway instead of a hose. In addition, if you would like to participate in our free Customer Water Conservation program, you can learn more about the program or enroll by going to our website at www.aquarionwater.com/conservationoffers.



Aquarion's Sample Results for PFAS

Aquarion Water Company sampled the Millbury System in 2019 and 2020 to test for PFAS compounds, out of an abundance of caution and concern. PFAS are unregulated contaminants for which there are no established drinking water standards. The purpose of monitoring unregulated contaminants is to assist regulatory agencies in determining their occurrence in drinking water and whether future regulation is warranted. However, the U.S. Environmental Protection Agency has set a Health Advisory level (HA) of 70 parts per trillion (ppt) for PFOS and PFOA, and the state Department of Environmental Protection's Office of Research and Standards (ORS) had set a goal (ORSG) of 70 ppt for PFOS, PFOA, PFNA, PFHxS and PFHpA individually or as a group. The ORSG was updated in January 2020 to 20 ppt for a group of 6 PFAS compounds (adding PFDA). Our system's reported PFAS results are less than 20 ppt, as shown below, except for one well that is not in use.

If you are a sensitive consumer (pregnant women, nursing mothers, and infants), you can

minimize your exposure by using bottled water that has been tested for PFAS for drinking, making infant formula and cooking foods that absorb water. Please consult your health practitioner if you have any health-related questions. For a consumer factsheet on PFAS see: www.mass.gov/info-details/per-and-polyfluoroalkyl-substances-pfas



Millbury System PFAS Sampling Results

Town/City: Millbury

All results reported as parts per trillion (ppt)

Water System Name	Sample Location	Test Date	PFOA	PFOS	PFHpA	PFHxS	PFNA	PFDA	Total PFAS (6)	MASSDEP MCL	Other PFAS Tested
Millbury	244 North Main St (Distribution)	2020 Q1 (Feb)	ND	ND	ND	ND	ND	ND	0	20	ND ND ND
	Oak Pond Well, (Raw)*	2020 Q1 (Feb)	11	11	22	3	ND	ND	47	NA	3 35 ND
	Oak Pond Well, (Raw)*	2020 Q1 (May)	8	9	18	4	2	ND	41	NA	4 26 ND
	Oak Pond Well, (Raw)*	2020 Q3 (August)	9	10	18	5	ND	ND	41	NA	2 24 ND
	Millbury Ave Well, POE	2020 Q4 (Nov)	2	ND	ND	ND	ND	ND	2	20	ND ND ND
	Jacques Lag Effluent	2020 Q1 (March)	ND	ND	ND	ND	ND	ND	0	20	ND 14 ND
	Jacques Lag Effluent	2020 Q2 (May)	ND	ND	ND	ND	ND	ND	0	20	ND ND ND
	Jacques Lag Effluent	2020 Q4 (Nov)	ND	ND	ND	ND	ND	ND	0	20	ND 3 ND

Footnote:

*Oak Pond Well was taken offline from the distribution system on 10/21/19, which is the day that PFAS sample results were received. Oak Pond Well has not supplied customers as of 10/21/19. No water from Oak Pond Well is entering the distribution system for customer consumption.

Definitions:

MCL – Maximum Contaminant Level

NA – Not applicable

ND – Not detected

NT – Not tested

Distribution – Sample collected from the distribution system, representative of water delivered to customers.

POE – Point of entry. Sample collected after treatment as water enters the distribution system, before the first customer.

Finished – Sample collected after treatment while well is run to waste. No water entering the distribution system for customer consumption.

Lag Effluent – Sample collected after treatment.

Raw – Sample collected before treatment.

(continued on page 11)

Important Information About Your Drinking Water

(continued from page 10)

Millbury System PFAS Sampling Results

Town/City: Millbury

All results reported as parts per trillion (ppt)

Water System Name	Sample Location	Test Date	PFOA	PFOS	PFHpA	PFHxS	PFNA	PFDA	Total PFAS (6)	MASSDEP MCL	Other PFAS Tested		
			ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
Millbury	Atchue Opticians (Distribution)	2019 Q4 (Nov.)	ND	ND	ND	ND	ND	ND	ND	20	ND	ND	ND
	312 Millbury Ave (Distribution)	2019 Q4 (Nov.)	ND	ND	ND	ND	ND	ND	ND	20	ND	3	ND
	244 North Main St (Distribution)	2019 Q4 (Nov.)	ND	ND	ND	ND	ND	ND	ND	20	ND	3	ND
	Oak Pond Well, POE*	2019 Q4 (October)	17	19	31	6	4	1	78	NA	4	51	ND
	Oak Pond Well, (Finished)*	2019 Q4 (October)	14	19	26	4	3	1	67	NA	6	42	ND
	Oak Pond Well, (Finished)*	2019 Q4 (Nov.)	17	23	28	5	3	1	78	NA	4	49	ND
	Oak Pond Well, (Raw)*	2019 Q4 (October)	14	20	26	4	3	1	68	NA	4	42	ND
	Oak Pond Well, (Raw)*	2019 Q4 (Nov.)	19	28	34	6	4	1	92	NA	6	53	ND
	Millbury Ave Well, POE	2019 Q4 (October)	3	4	1	1	ND	ND	9	20	1	1	ND
	Jacques Wells, POE	2019 Q4 (October)	ND	ND	ND	ND	ND	ND	ND	20	ND	3	1

Footnotes and Definitions: See previous page.

Monitoring Requirement Not Met for Millbury Water System

Our water system violated a drinking water sampling requirement in 2020. Even though this sampling error was not an emergency, as our customers, you have a right to know what happened and what we did to correct these situations.

We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not our drinking water meets health standards. During 2020, we were required to sample for lead and copper at 20 customers' homes, but we only obtained 18 samples, because 2 samples were invalidated by MA DEP. Although we cannot be sure of the quality of our drinking in all 20 homes, the results from the 18 samples we did take were all within acceptable drinking water levels for both lead and copper. Aquarion distributed the sampling results to all customers participating in the program.

What should I do?

There is nothing you need to do at this time.

The table below lists the contaminants that we did not properly test for during the last year, how often we are supposed to sample for these contaminants, how many samples we are supposed to take, and how many samples we took, when samples should have been taken, and the date on which follow-up samples will be taken:

Contaminants	Required sampling frequency	Number of samples taken	When all samples should have been taken	When samples were or will be taken
Lead and Copper	20 samples from customers' taps, once every 3 years	18	2020	Summer 2021

What happened? What is being done?

The Millbury Water System is required to sample customers' tap water from 20 DEP-approved locations once every 3 years. In 2020, we were only able to obtain 18 samples during the required sampling period (June – September). As a result, we will need to resample for lead and copper at 20 targeted and DEP-approved customer sites in 2021 between June and September. Customers participating in the program will receive their sampling results in the mail.

For more information, please contact Paul Lawson at 508-685-3992, plawson@aquarionwater.com or send a letter to 24 Providence Street, Millbury, MA.


Water Conservation Works!

MillburySystem PWS ID#: MA2186000

By reducing water consumption, Aquarion customers have made outstanding progress in ensuring that our area has enough water, no matter what the skies deliver. Many thanks to all the customers who cut back on outdoor sprinkler irrigation and other uses, helping to save more than 2 billion gallons of water across our systems over the last three years. There's still more to do, though. Here are some easy tips on what everyone can do to conserve the supply of this irreplaceable resource:

Reduce excessive irrigation. Get rid of wasteful, "set 'em and forget 'em" clock timers. Water only when the ground feels dry. Use WaterSense-labeled spray sprinkler bodies.

Rely more on the sky. Put a rain barrel under a downspout to capture rainwater for your garden.



Forget fertilizing. Many use salts that make your lawn less drought-resistant.

Enjoy an edible landscape. Replace turf with berry bushes or fruit trees – they use less water.



Fill it up! Wait until you have a full load before running your washing machine and dishwasher.

Look at labels. Washing machines and dishwashers certified by ENERGY STAR use far less water. WaterSense-labeled fixtures do the same.

Jilt the jiggling. Fix leaky toilets. Watch our step-by-step video at www.aquarionwater.com about finding and fixing leaks. Better yet, upgrade to a new, WaterSense-labeled model to save three or more gallons with every flush.



Turn off the taps. While brushing your teeth, shaving or just groping for a towel, keep good, clean water from disappearing down the drain.

Catch this idea. While waiting for tap or shower water to warm up, capture the cooler water in a container for watering plants.

Recycle cooking water. Save water used for cooking pasta and vegetables – it's great for plants.

Shorten shower times. You will use less water– and reduce energy costs, too.



Put scraps to work. Compost vegetable scraps to nourish your garden, instead of using water to grind them up in your garbage disposal.

Put a chill on waste. Keep a pitcher of drinking water in the fridge so you don't have to run the tap until the water gets cold.

Conserving water quickly becomes second nature. For many more ways to ensure that your water supply stays healthy for decades to come, check out the tips at www.aquarionwater.com/conserve.

Questions About Your Water Quality Report?

Customers who have questions about water quality should call us at 800-832-2373. Customers also may email us at www.waterquality@aquarionwater.com, or visit www.aquarionwater.com/MA.

For other questions, or to report discolored water/service problems, or if you would like to participate in a public meeting, call 800-732-9678.

Massachusetts Department of Environmental Protection:

www.mass.gov/info-details/public-drinking-water-system-operations

U.S. Environmental Protection Agency's Safe Drinking Water Hotline: 800-426-4791 or www.epa.gov/safewater